

ABBREVIATIONS

Table of abbreviations for architectural and construction terms, including ANCHOR BOLT, ANCHOR, AIR CONDITIONING, ASPHALTIC CONCRETE, etc.


PROJECT INFORMATION

1,030 SQ. FT. REMODEL AND 1,220 SQ. FT. ADDITION TO SINGLE-FAMILY RESIDENCE
LOCATION: 74 WOODHAMS RD
APN: 296-12-031
LEGAL DESCRIPTION: APPROX 6,264 SQ.FT.
LOT AREA: 6,264 SQ.FT.
ZONE: R-1-6L
CONSTRUCTION TYPE: V-B, NON-SPRINKLERED
OCCUPANCY: R-3 / U


CODES

- 1. THE GOVERNING CODES FOR THIS PROJECT ARE THE 2022 CALIFORNIA RESIDENTIAL (CRC), ELECTRICAL (CEC), MECHANICAL (CMC), PLUMBING (CPC), FIRE (CFC) CODES, ENERGY CODE (ENS) AND GREEN CODE (CGSB).
2. THE STRUCTURAL DESIGN OF THIS PROJECT SHALL COMPLY WITH THE REQUIREMENTS OF THE 2022 CALIFORNIA BUILDING CODE (CBC) AND ENGINEERING PRINCIPLES.
3. ALL WORK SHALL CONFORM TO ALL REQUIREMENTS OF STATE OF CALIFORNIA TITLE 24 REGARDLESS OF THE INFORMATION INDICATED ON THESE PLANS. IT IS THE RESPONSIBILITY OF THE INDIVIDUAL SUPERVISING THE CONSTRUCTION TO ENSURE THAT THE WORK IS DONE IN ACCORDANCE WITH CODE REQUIREMENTS PRIOR TO REQUESTING INSPECTION.

SYMBOLS

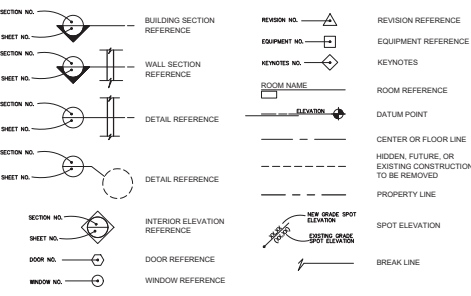

VICINITY MAP

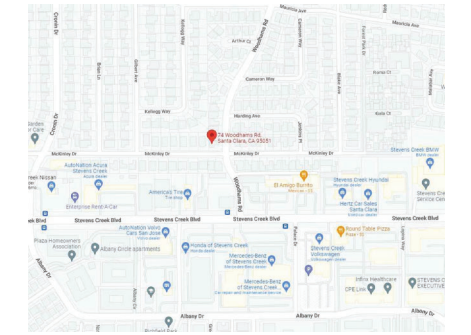


PROJECT CONTACTS

OWNER: WINNIE CHAN YAMAKITA
YUSUKE YAMAKITA
74 WOODHAMS ROAD
SANTA CLARA, CA, 95051
DESIGNER: LEO CHUJANG
912 SUMMIT PLACE
MONTEREY PARK, CA, 91754
626.927.7070

CALCULATIONS

LOT AREA: 6,264 SQ. FT.
ALLOWABLE LOT COVERAGE: 40% = 2,506 SQ. FT.
EXISTING FLOOR AREA: 1,673 SQ. FT.
EXISTING GARAGE: 418 SQ. FT.
PROPOSED FLOOR AREA:
EXISTING RESIDENCE: 1,673 SQ. FT.
FIRST FLOOR ADDITION: 238 SQ. FT.
SECOND FLOOR ADDITION: 892 SQ. FT.
(N) TOTAL FLOOR AREA: 2,893 SQ. FT.
LOT COVERAGE:
TOTAL LOT COVERAGE: 2,398 SQ. FT.
PERCENTAGE OF LOT COVERAGE: 38.3%

RENDERING

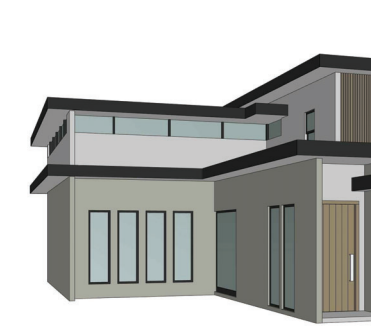

SHEET INDEX

Table listing architectural sheets: ARCHITECTURAL A0.0 TITLE SHEET, A1.1 EXISTING SITE PLAN, A1.2 PROPOSED SITE PLAN, A2.1 EXISTING FLOOR PLAN, A2.2 PROPOSED FIRST FLOOR PLAN, A2.3 PROPOSED SECOND FLOOR PLAN, A4.1 EXISTING ROOF PLAN, A4.2 PROPOSED ROOF PLAN, A6.1 EXISTING ELEVATIONS, A6.2 PROPOSED ELEVATIONS, A6.3 PROPOSED ELEVATIONS, A8.1 DOOR AND WINDOW SCHEDULES

REVISIONS

Table for tracking revisions with columns for revision number and description.

BY

Table for tracking the author of each revision.


TITLE SHEET

YAMAKITA RESIDENCE
74 WOODHAMS ROAD
Santa Clara, CA, 95051

Date:
Sheet:

A0.0

**EXISTING SITE PLAN**

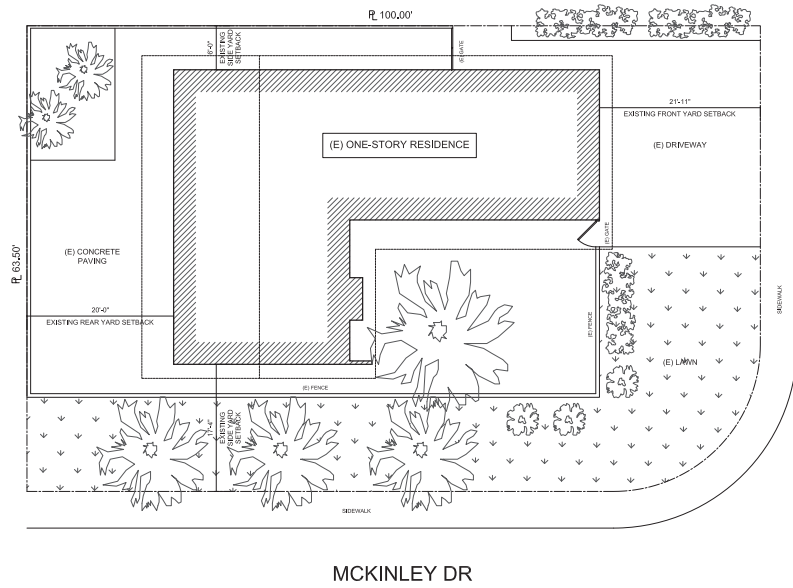

MCKINLEY DR

WOODHAMS RD




REVISIONS	BY

EXISTING SITE PLAN  
**YAMAKITA RESIDENCE**  
 74 WOODHAMS ROAD  
 Santa Clara, CA, 95051

Date: \_\_\_\_\_  
 Sheet: **A1.1**

**PROPOSED SITE PLAN**

SCALE: 1/8" = 1'-0"

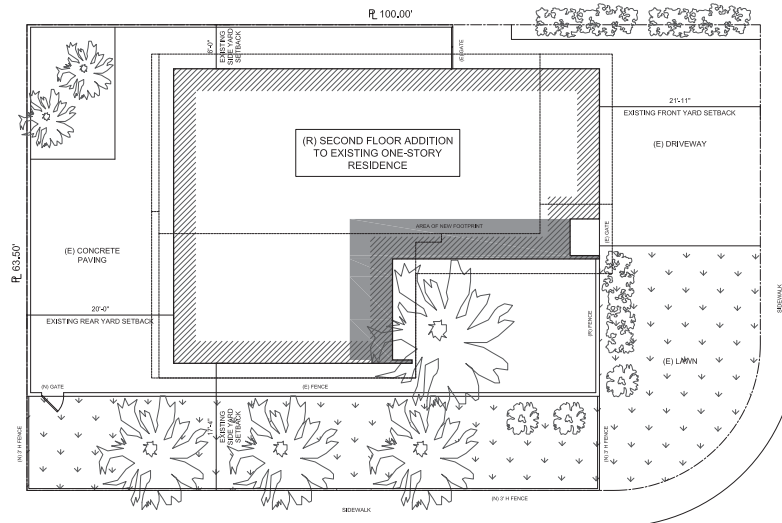

MCKINLEY DR

WOODHAMS RD




REVISIONS	BY

PROPOSED SITE PLAN  
**YAMAKITA RESIDENCE**  
 74 WOODHAMS ROAD  
 Santa Clara, CA, 95051

**A1.2**

EXISTING WALL  
 PROPOSED NEW WALL

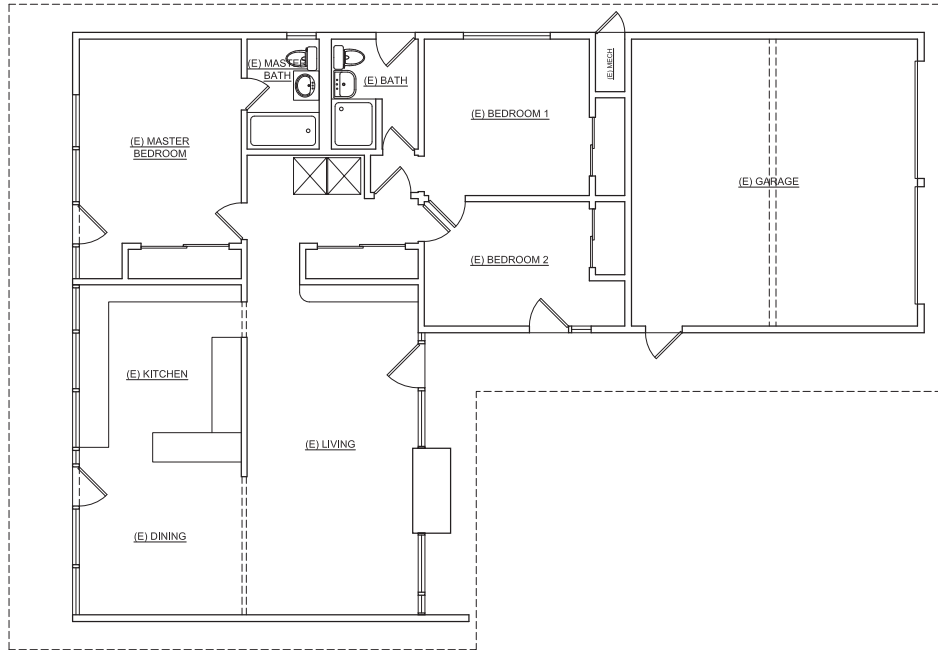

**EXISTING FLOOR PLAN**

SCALE: 1/4" = 1'-0"



REVISIONS	BY

EXISTING FLOOR PLAN  
**YAMAKITA RESIDENCE**  
 74 WOODHAMS ROAD  
 Santa Clara, CA, 95051

Date: \_\_\_\_\_  
 Sheet: **A2.1**

**NOTES**


1. WALL COVERINGS IN SHOWERS AND TUBS WITH SHOWERHEADS SHALL BE CEMENT PLASTER OR TILE EQUAL OR HIGHER THAN 7'0" ABOVE DRAIN. ENCLOSURES MUST BE OF APPROVED SAFETY GLAZING AND DOORS (22" MIN WIDTH MUST SWING OUT OF SHOWERS, WINDOWS IN ENCLOSURE WALLS SHALL BE LABELED SAFETY GLAZING WHEN LESS THAN 6'0" ABOVE THE DRAIN, CBC SEC. 1210.3, CPC SEC. 411.7.
- 1A. REINFORCED GYPSUM BACKERS SHALL BE USED AS A BASE FOR WALL TILE IN TUB AND SHOWER AREAS AND WALL AND CEILING PENALS IN SHOWER AREAS. (R702.4.2 CRC)
2. PROVIDE AN EXHAUST FAN 50 CFM MIN. IN ALL BATHROOMS. SEE ELECTRICAL PLANS (E2.1, E2.2) FOR EXHAUST SYSTEM LOCATIONS. EXHAUST OUTLET MUST BE MINIMUM 3' FROM ANY OPENINGS INTO BUILDING AND PROPERTY LINE. CMC SEC. 402.2.1, 403.7, CMC TABLE 44, CBC SEC. 1200.4.2.1.
3. SMOKE/CARBON MONOXIDE ALARMS SHALL BE HARD-WIRED WITH A BATTERY BACKUP AND INTERCONNECTED SO THAT THE ACTIVATION OF ONE ALARM SHALL ACTIVATE ALL OTHER ALARMS IN THE DWELLING UNIT. RETROFIT SMOKE ALARMS MAY BE BATTERY OPERATED. (PER CRC SECTION 314 AND SECTION 315)
4. ALL DOORS PROVIDING ACCESS FROM HOUSE TO POOL AREA SHALL BE EQUIPPED WITH EXIST ALARMS OPERABLE UPON OPENING OF THE DOOR.
5. ALL GLAZING IN HAZARDOUS LOCATIONS MUST BE IDENTIFIED BY A LABEL (PERMANENT IF TEMPERED AS SAFETY GLAZING, HAZARDOUS LOCATIONS ARE IDENTIFIED AS FOLLOWS:
  - A. GLAZING IN ALL DOORS
  - B. GLAZING IN DOORS, WALLS (WITH THE EXPOSED EDGE OF GLAZING LESS THAN 6'0" ABOVE DRAIN INLET) AND ENCLOSURES FOR BATHTUBS, SHOWERS, WHIRLPOOLS, SPAS, ETC.
  - C. GLAZING WITHIN A 24" ARC OF A DOOR EDGE.
  - D. GLAZING PANELS OVER 9 SQUARE FEET HAVING THE LOWEST EDGE LESS THAN 18" ABOVE THE FINISH FLOOR AND HAVING A TOP EDGE GREATER THAN 36" ABOVE THE FLOOR, AND WITH 36" HORIZONTALLY OF A WALKING SURFACE.
  - E. GLAZING IN GUARDRAILS.
  - F. GLAZING IN WALL/FENCES USED AS POOL BARRIER FOR INDOOR AND OUTDOOR SWIMMING POOL.
  - G. GLAZING WITHIN 36" HORIZONTALLY FROM THE WALKING SURFACE STAIRWAYS WITH BOTTOM EDGE LESS THAN 6'0" ABOVE WALKING SURFACE.

6. THE LARGEST RISE OR RUN IN A FLIGHT OF STAIRS MAY NOT EXCEED THE SMALLEST BY MORE THAN 3/8". PROTECTIVE GUARDS ON OPEN SIDE OF STAIRS OVER 3'0" ABOVE THE FLOOR OR ADJACENT GRADE MAY SERVE AS HANDRAIL. GUARD AND HANDRAILS ASSEMBLY MAY BE 34"-38" HIGH ONLY AT OPEN SIDE OF STAIRS. HANDRAIL (REQUIRED FOR 4 OR MORE RISERS) AT 34"-38" ABOVE TREAD NOSING, 1 1/2" CLEARANCE TO WALL, 1 1/4" TO 2" IN CROSS SECTION, WITH ENDS RETURN TO WALL OR FLOOR OR TERMINATE AT NEELER OR SAFETY POST.
7. GUARDRAILS ARE REQUIRED AT FLOOR AND ROOF OPENINGS, LANDINGS, BALCONIES, AND AT OPEN SIDES OF STAIRS OVER 3'0" IN HEIGHT. OPEN GUARDRAILS SHALL HAVE INTERMEDIATE RAILS OR AN ORNAMENT PATTERN SUCH THAT A 4.375" SPHERE CANNOT PASS THROUGH.
8. EGRESS WINDOWS
  - BEDROOM EGRESS WINDOWS HAVE A MINIMUM CLEAR OPENING AREA OF 5.7 SF. ABOVE THE GRADE-FLOOR, A MINIMUM NET HEIGHT OF 2'0" AND MINIMUM NET WIDTH OF 2'0", AND A SILL HEIGHT NOT MORE THAN 44" MAXIMUM ABOVE FINISH FLOOR.
  - FIRE BLOCKING IS REQUIRED IN CONCEALED SPACES 1'0" O.C. HORIZONTALLY AND VERTICALLY IN THE CEILING AND FLOOR LEVELS, CONNECTIONS BETWEEN HORIZONTAL AND VERTICAL SPACES, CONCEALED SPACES BETWEEN STAIR AND LANDING, OPENINGS AROUND VENTS, PIPES, DUCTS, CABLES, WIRES, CHIMNEYS AND FIREPLACES.


10. HEAT DETECTORS SHALL BE INSTALLED PER SMOCS 12.14 IN THE FOLLOWING LOCATIONS IN THE ATTIC, ITICEN, BASEMENT AND ATTACHED GARAGE.
11. LANDING SHALL NOT HAVE A WIDTH NOT LESS THAN THE WIDTH OF DOOR AND LENGTH IN THE DIRECTION OF TRAVEL OF NOT LESS THAN 36". WILL BE PROVIDED ON EACH SIDE OF DOORS. THE ELEVATION OF LANDINGS SHALL NOT EXCEED 1.5" LOWER THAN THE TOP OF THE THRESHOLD OF THE DOORWAY (7.78 IN) IF THE DOOR DOES NOT SWING OVER THE LANDING OR STEPS.
12. BATHROOMS, WATER CLOSETS OR SIMILAR ROOMS SHALL BE PROVIDED WITH GLAZED AREA IN WINDOWS OF NOT LESS THAN 3 SQ. FT. ONE HALF SHALL BE STAINLESS (R302.3). EXCEPTION: THE GLAZED AREAS SHALL NOT BE REQUIRED WHERE ARTIFICIAL LIGHT AND A LOCAL EXHAUST SYSTEM ARE PROVIDED. THE MINIMUM LOCAL EXHAUST RATES SHALL BE 50 CUBIC FT PER INTERMITTENT VENTILATION OR 20 CFM FOR CONTINUOUS VENTILATION IN ACCORDANCE WITH THE CMC, CHAPTER 4. EXHAUST IR FROM THE SPACE SHALL BE EXHAUSTED DIRECTLY TO THE OUTDOORS.
13. FIREPLACES SHALL HAVE: (A) CLOSABLE METAL OR GLASS COVERING OVER THE ENTIRE OPENING OF THE FIREBOX. (B) COMBUSTION AIR INTAKE FROM OUTSIDE OF THE BUILDING DIRECTLY INTO FIREBOX OF AT LEAST 6 SQ. IN. AND HAS AN ACCESSIBLE, OPERABLE AND TIGHT FITTING DAMPER OR COMBUSTION AIR CONTROL DEVICE. (C) A FLUE DAMPER WITH A READILY ACCESSIBLE CONTROL.
14. CONTINUOUS BURNING PILOT LIGHTS AND THE USE OF INDOOR AIR FOR COOLING A FIREBOX JACKET, WHEN THAT INDOOR AIR IS VENTED TO THE OUTSIDE OF THE BUILDING, ARE PROHIBITED.
15. WALLS AND CEILING FINISHES SHALL HAVE A FLAME SPREAD CLASSIFICATION OF NO GREATER THAN 200, AND A SMOKE DEVELOPED INDEX OF NOT GREATER THAN 450 (CRC R302.9)
16. THRESHOLDS OVER 0.25" SHALL BE BEVELED 1:2

- PLUMBING NOTES:**
1. ALL PLUMBING MATERIALS USED IN THE WATER SUPPLY SYSTEM, EXCEPT FOR VALVES AND SIMILAR DEVICES SHALL BE OF BRASS, COPPER, CAST IRON OR OTHER APPROVED MATERIAL.
  2. NO VENT SHALL TERMINATE IN A LOCATION THAT IS VISIBLE FROM THE PARKWAY ACROSS THE STREET FROM THE SUBJECT PROPERTY. OFF-SET VENTING SHALL COMPLY WITH CPC 518 OR 706.
  3. NO SOL, WASTE OR OTHER PIPE OR CONDUIT, OTHER THAN DOWNSPOUTS SHALL BE INSTALLED OR PERMITTED ON THE OUTSIDE OF THE BUILDING.
  4. ALL PLUMBING MATERIAL USED IN THE WATER SUPPLY SYSTEM, EXCEPT VALVES AND SIMILAR DEVICES SHALL BE OF LIKE MATERIALS.
  5. PIPING MATERIALS:
    - WASTE: PVC DWV
    - VENT: PVC DWV
    - WATER: COPPER
    - GAS: BLACK STEEL

1. ALL PLUMBING MATERIALS USED IN THE WATER SUPPLY SYSTEM, EXCEPT FOR VALVES AND SIMILAR DEVICES SHALL BE OF BRASS, COPPER, CAST IRON OR OTHER APPROVED MATERIAL.
2. NO VENT SHALL TERMINATE IN A LOCATION THAT IS VISIBLE FROM THE PARKWAY ACROSS THE STREET FROM THE SUBJECT PROPERTY. OFF-SET VENTING SHALL COMPLY WITH CPC 518 OR 706.
3. NO SOL, WASTE OR OTHER PIPE OR CONDUIT, OTHER THAN DOWNSPOUTS SHALL BE INSTALLED OR PERMITTED ON THE OUTSIDE OF THE BUILDING.
4. ALL PLUMBING MATERIAL USED IN THE WATER SUPPLY SYSTEM, EXCEPT VALVES AND SIMILAR DEVICES SHALL BE OF LIKE MATERIALS.
5. PIPING MATERIALS:
  - WASTE: PVC DWV
  - VENT: PVC DWV
  - WATER: COPPER
  - GAS: BLACK STEEL

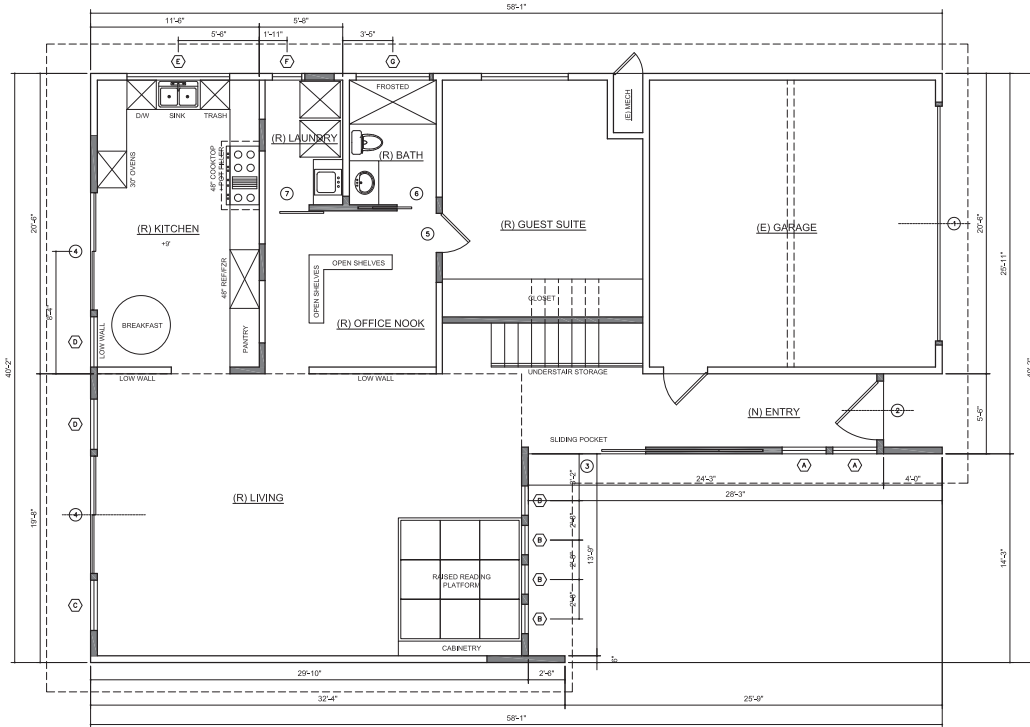

**PROPOSED FIRST FLOOR PLAN**



REVISIONS	BY

PROPOSED FIRST FLOOR PLAN  
**YAMAKITA RESIDENCE**  
 74 WOODHAMS ROAD  
 Santa Clara, CA, 95051

**A2.2**

**NOTES**

1. WALL COVERINGS IN SHOWERS AND TUBS WITH SHOWERHEADS SHALL BE CEMENT PLASTER OR TILE, EQUAL OR HIGHER THAN 7'0" ABOVE DRAIN. ENCLOSURES MUST BE OF APPROVED SAFETY GLAZING AND DOORS 22" MIN WIDTH MUST SWING OUT OF SHOWERS. WINDOWS IN ENCLOSURE WALLS SHALL BE LABELED SAFETY GLAZING WHEN LESS THAN 6'0" ABOVE THE DRAIN. CBC SEC. 1210.3, CPC SEC. 411.7.

1A. REINFORCED GYPSUM BACKERS SHALL BE USED AS A BASE FOR WALL TILE IN TUB AND SHOWER AREAS AND WALL AND CEILING PENALS IN SHOWER AREAS. (R702.4.2 CRC)

2. PROVIDE AN EXHAUST FAN 50 CFM MIN. IN ALL BATHROOMS. SEE ELECTRICAL PLANS (E2, E2.2) FOR EXHAUST SYSTEM LOCATIONS. EXHAUST OUTLET MUST BE MINIMUM 5' FROM ANY OPENINGS INTO BUILDING AND PROPERTY LINE. CMC SEC. 402.2.1, 403.7, CMC TABLE 44, CBC SEC. 1203.4.2.1.

3. SMOKE/CARBON MONOXIDE ALARMS SHALL BE HARD-WIRED WITH A BATTERY BACKUP AND INTERCONNECTED SO THAT THE ACTIVATION OF ONE ALARM SHALL ACTIVATE ALL OTHER ALARMS IN THE DWELLING UNIT. RETROFIT SMOKE ALARMS MAY BE BATTERY OPERATED. (PER CRC SECTION 314 AND SECTION 315)

4. ALL DOORS PROVIDING ACCESS FROM HOUSE TO POOL AREA SHALL BE EQUIPPED WITH EXIST ALARMS OPERABLE UPON OPENING OF THE DOOR.

5. ALL GLAZING IN HAZARDOUS LOCATIONS MUST BE IDENTIFIED BY A LABEL (PERMANENT IF TEMPERED AS SAFETY GLAZING, HAZARDOUS LOCATIONS ARE IDENTIFIED AS FOLLOWS:

- A. GLAZING IN ALL DOORS
- B. GLAZING IN DOORS, WALLS (WITH THE EXPOSED EDGE OF GLAZING LESS THAN 6'0" ABOVE DRAIN INLET) AND ENCLOSURES FOR BATHTUBS, SHOWERS, WHIRLPOOLS, SPAS, ETC.
- C. GLAZING WITHIN A 24" ARC OF A DOOR EDGE.
- D. GLAZING PANELS OVER 9 SQUARE FEET HAVING THE LOWEST EDGE LESS THAN 18" ABOVE THE FINISH FLOOR AND HAVING A TOP EDGE GREATER THAN 36" ABOVE THE FLOOR, AND WITH 30" HORIZONTALLY OF A WALKING SURFACE.
- E. GLAZING IN GUARDRAILS.
- F. GLAZING IN WALL/FENCES USED AS POOL BARRIER FOR INDOOR AND OUTDOOR SWIMMING POOL.
- G. GLAZING WITHIN 36" HORIZONTALLY FROM THE WALKING SURFACE STAIRWAYS WITH BOTTOM EDGE LESS THAN 6'0" ABOVE WALKING SURFACE.

6. THE LARGEST RISE OR RUN IN A FLIGHT OF STAIRS MAY NOT EXCEED THE SMALLEST BY MORE THAN 30". PROTECTIVE GUARDS ON OPEN SIDES OF STAIRS OVER 30" ABOVE THE FLOOR OR ADJACENT GRADE MAY SERVE AS HANDRAIL. GUARD AND HANDRAILS ASSEMBLY MAY BE 34"-38" HIGH ONLY AT OPEN SIDE OF STAIRS. HANDRAIL (REQUIRED FOR 4 OR MORE RISERS) AT 34"-38" ABOVE TREAD NOSING, 1 1/2" CLEARANCE TO WALL, 1 1/4" TO 2" IN CROSS SECTION, WITH ENDS RETURN TO WALL OR FLOOR OR TERMINATE AT NEVEL OR SAFETY POST.

7. GUARDRAILS ARE REQUIRED AT FLOOR AND ROOF OPENINGS, LANDINGS, BALCONIES, AND AT OPEN SIDES OF STAIRS OVER 30" IN HEIGHT. OPEN GUARDRAILS SHALL HAVE INTERMEDIATE RAILS OR AN ORNAMENT PATTERN SUCH THAT A 4.375" SPHERE CANNOT PASS THROUGH.

8. EGRESS WINDOWS  
BEDROOM EGRESS WINDOWS HAVE A MINIMUM CLEAR OPENING AREA OF 5.7 SF. ABOVE THE GRADE-FLOOR, A MINIMUM NET HEIGHT OF 24" AND MINIMUM NET WIDTH OF 20". AND A SILL HEIGHT NOT MORE THAN 44" MAXIMUM ABOVE FINISH FLOOR.

9. FIRE BLOCKING IS REQUIRED IN CONCEALED SPACES 10" O.C. HORIZONTALLY AND VERTICALLY IN THE CEILING AND FLOOR LEVELS, CONNECTIONS BETWEEN HORIZONTAL AND VERTICAL SPACES, CONCEALED SPACES BETWEEN STAIR AND LANDING, OPENINGS AROUND VENTS, PIPES, DUCTS, CABLES, WIRES, CHIMNEYS AND FIREPLACES.

10. HEAT DETECTORS SHALL BE INSTALLED PER SMOCS 12.14 IN THE FOLLOWING LOCATIONS IN THE ATTIC, KITCHEN, BASEMENT AND ATTACHED GARAGE.

11. LANDING SHALL NOT HAVE A WIDTH NOT LESS THAN THE WIDTH OF DOOR AND LENGTH IN THE DIRECTION OF TRAVEL OF NOT LESS THAN 36". WILL BE PROVIDED ON EACH SIDE OF DOORS. THE ELEVATION OF LANDINGS SHALL NOT EXCEED 1.5" LOWER THAN THE TOP OF THE THRESHOLD OF THE DOORWAY (7.78INCH IF THE DOOR DOES NOT SWING OVER THE LANDING OR STEPS.

12. BATHROOMS, WATER CLOSETS OR SIMILAR ROOMS SHALL BE PROVIDED WITH GLAZED AREA IN WINDOWS OF NOT LESS THAN 3 SQ. FT. ONE HALF SHALL BE TEMPERED (R702.3). EXCEPTION: THE GLAZED AREAS SHALL NOT BE REQUIRED WHERE ARTIFICIAL LIGHT AND A LOCAL EXHAUST SYSTEM ARE PROVIDED. THE MINIMUM LOCAL EXHAUST RATES SHALL BE 50 CUBIC FPM FOR INTERMITTENT VENTILATION OR 20 CFM FOR CONTINUOUS VENTILATION IN ACCORDANCE WITH THE CMC, CHAPTER 4. EXHAUST IR FROM THE SPACE SHALL BE EXHAUSTED DIRECTLY TO THE OUTDOORS.

13. FIREPLACES SHALL HAVE: (A) CLOSABLE METAL OR GLASS COVERING OVER THE ENTIRE OPENING OF THE FIREBOX. (B) COMBUSTION AIR INTAKE FROM OUTSIDE OF THE BUILDING DIRECTLY INTO FIREBOX OF AT LEAST 6 SQ. IN. AND HAS AN ACCESSIBLE, OPERABLE AND TIGHT FITTING DAMPER OR COMBUSTION AIR CONTROL DEVICE. (C) A FLUE DAMPER WITH A READILY ACCESSIBLE CONTROL.

14. CONTINUOUS BURNING PILOT LIGHTS AND THE USE OF INDOOR AIR FOR COOLING A FIREBOX JACKET, WHEN THAT INDOOR AIR IS VENTED TO THE OUTSIDE OF THE BUILDING, ARE PROHIBITED.

15. WALLS AND CEILING FINISHES SHALL HAVE A FLAME SPREAD CLASSIFICATION OF NO GREATER THAN 200, AND A SMOKE DEVELOPED INDEX OF NOT GREATER THAN 450 (CRC R302.9)

16. THRESHOLDS OVER 0.20" SHALL BE BEVELED 1:2

**PLUMBING NOTES:**


1. ALL PLUMBING MATERIALS USED IN THE WATER SUPPLY SYSTEM, EXCEPT FOR VALVES AND SIMILAR DEVICES SHALL BE OF BRASS, COPPER, CAST IRON OR OTHER APPROVED MATERIAL.

2. NO VENT SHALL TERMINATE IN A LOCATION THAT IS VISIBLE FROM THE PARKWAY ACROSS THE STREET FROM THE SUBJECT PROPERTY. OFF-SET VENTING SHALL COMPLY WITH CPC 518 OR 706.

3. NO SOL. WASTE OR OTHER PIPE OR CONDUIT, OTHER THAN DOWNSPOUTS SHALL BE INSTALLED OR PERMITTED ON THE OUTSIDE OF THE BUILDING.

4. ALL PLUMBING MATERIAL USED IN THE WATER SUPPLY SYSTEM, EXCEPT VALVES AND SIMILAR DEVICES SHALL BE OF LIKE MATERIALS.

5. PIPING MATERIALS:
- WASTE: PVC DWV
  - VENT: PVC DWV
  - WATER: COPPER
  - GAS: BLACK STEEL

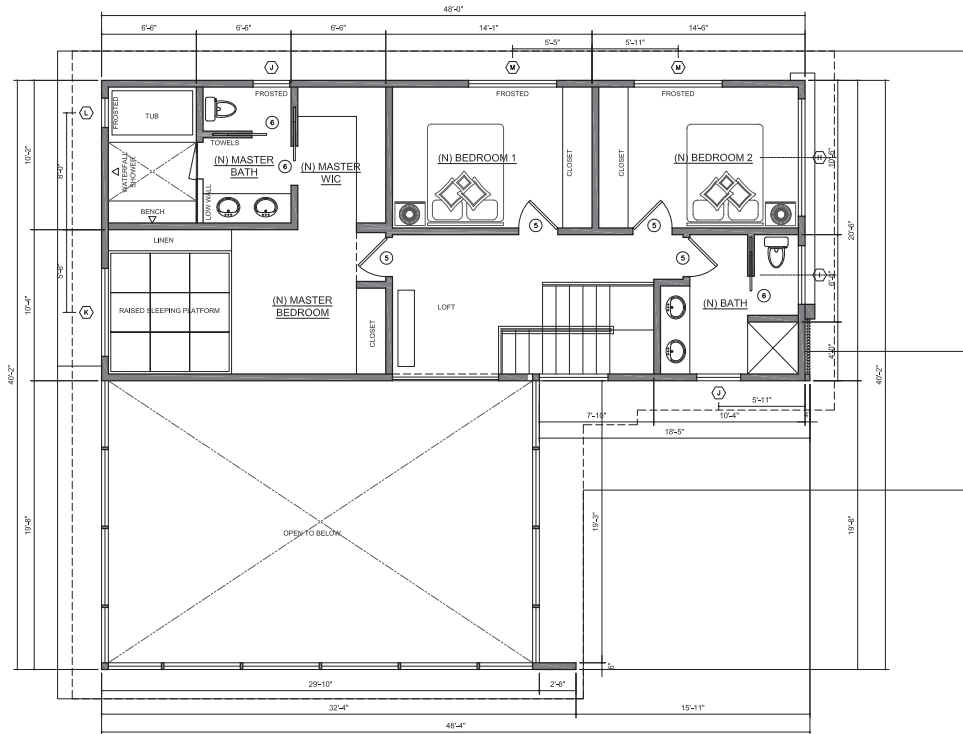

**PROPOSED SECOND FLOOR PLAN**




REVISIONS	BY


PROPOSED SECOND FLOOR PLAN  
**YAMAKITA RESIDENCE**  
 74 WOODHAMS ROAD  
 Santa Clara, CA, 95051

Date: \_\_\_\_\_  
 Sheet: **A2.3**

REVISIONS	BY

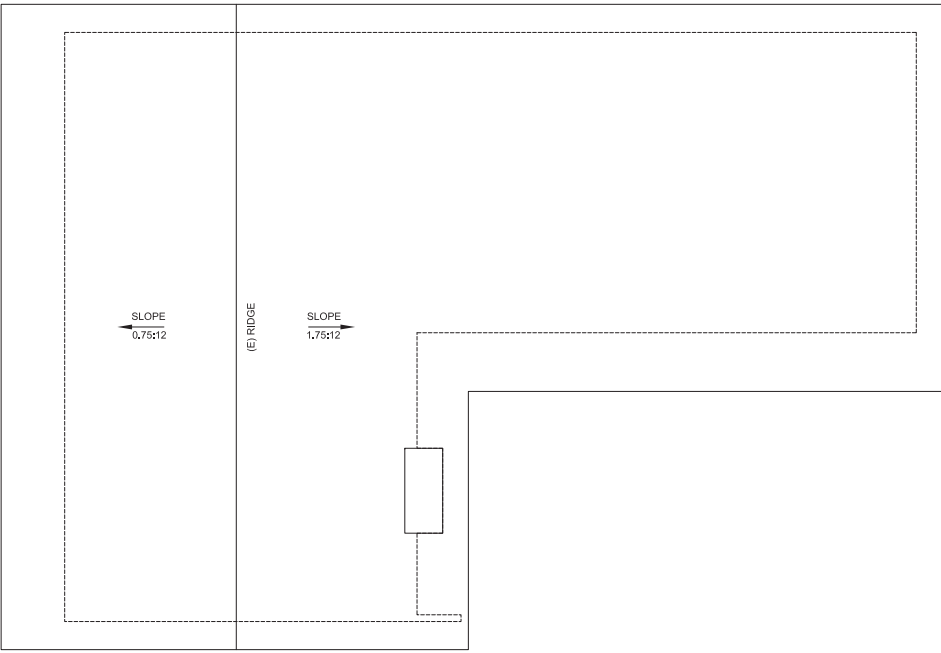

**EXISTING ROOF PLAN**



EXISTING ROOF PLAN  
**YAMAKITA RESIDENCE**  
 74 WOODHAMS ROAD  
 Santa Clara, CA, 95051

Date: \_\_\_\_\_  
 Sheet: **A4.1**

**ROOFING MATERIALS:**


SOPREMA ROOFING AND WATERPROOFING SYSTEM  
 SOPRSTAR SANDED  
 CLASS A ROOF COVERING  
 BUILT-UP ROOF

SPECIFICATION REQUIREMENTS TO MEET  
 ASTM D 6222, ASTM E 108, UL 790.


\*NOTE - ROOF GUTTERS/DRAINS SHALL BE PROVIDED WITH A MEANS TO PREVENT THE ACCUMULATION OF LEAVES AND DEBRIS IN THE GUTTER/DRAIN, (RESIDENTIAL CODE R337.5.4 AND BUILDING CODE 705A.4)

**NOTES:**

- ENCLOSED ATTICS AND ENCLOSED RAFTER SPACE FORMED WHERE CEILINGS ARE APPLIED DIRECTLY TO THE UNDERSIDE OF ROOF RAFTERS SHALL HAVE CROSS VENTILATION FOR EACH SEPARATE SPACE BY VENTILATING OPENINGS PROTECTED AGAINST THE ENTRANCE OF RAIN OR SNOW. VENTILATION OPENINGS SHALL HAVE A LEAST DIMENSION OF 3/8 INCH MINIMUM AND 1/2 INCH MAXIMUM. VENTILATION OPENINGS HAVING A LEAST DIMENSION LARGER THAN 1/2 INCH SHALL BE PROVIDED WITH CORROSION-RESISTANT WIRE CLOTH SCREENING, HARDWARE CLOTH, PERFORATED VINYL OR SIMILAR MATERIAL WITH OPENINGS HAVING A LEAST DIMENSION OF 1/8 INCH MINIMUM AND 1/2 INCH MAXIMUM (CRC R906.1).
- THE MINIMUM NET FREE VENTILATING AREA SHALL BE 1/6 OF THE AREA OF THE VENTED SPACE (CRC R906.2).
- VENTILATORS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS. INSTALLATION OF VENTILATORS IN ROOF SYSTEMS SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF SECTION R903. INSTALLATION OF VENTILATORS IN WALL SYSTEMS SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF SECTION R703.1 (CRC R906.4).
- ROOF ASSEMBLIES SHALL BE INSTALLED IN ACCORDANCE TO THE PROVISIONS OF CHAPTER 8 OF THE RESIDENTIAL CODE AND SHALL BE AN ICC-ES OR UL LISTED CLASS 'A' FIRE-RESISTIVE ROOF ASSEMBLY COMPLYING WITH ASTM E198 OR UL 790.
- VENTS SHALL RESIST THE INTRUSION OF FLAME AND EMBERS THROUGH THE VENTILATION OPENINGS. VENT OPENINGS SHALL BE PROTECTED BY CORROSION-RESISTANT, NONCOMBUSTIBLE WIRE MESH WITH A MINIMUM 3/8" OPENINGS AND SHALL NOT EXCEED 1/2". VENTS SHALL NOT BE INSTALLED IN EAVES OR CORNICES. (PER CBC 706A.2 AND CRC R327.6.1)
- A MIN. OF 1" AIR SPACE SHALL BE PROVIDED BETWEEN INSULATION AND ROOF SHEATHING
- CLASS I OR II VAPOR BARRIER SHALL BE INSTALLED ON THE WARM-IN-WINTER SIDE OF THE CEILING IN ACCORDANCE TO THE PROVISIONS OF CHAPTER 8 SECTION R806.2 OF THE RESIDENTIAL CODE
- PROVIDE VAPOR RETARDER AT ROOF JOISTS.

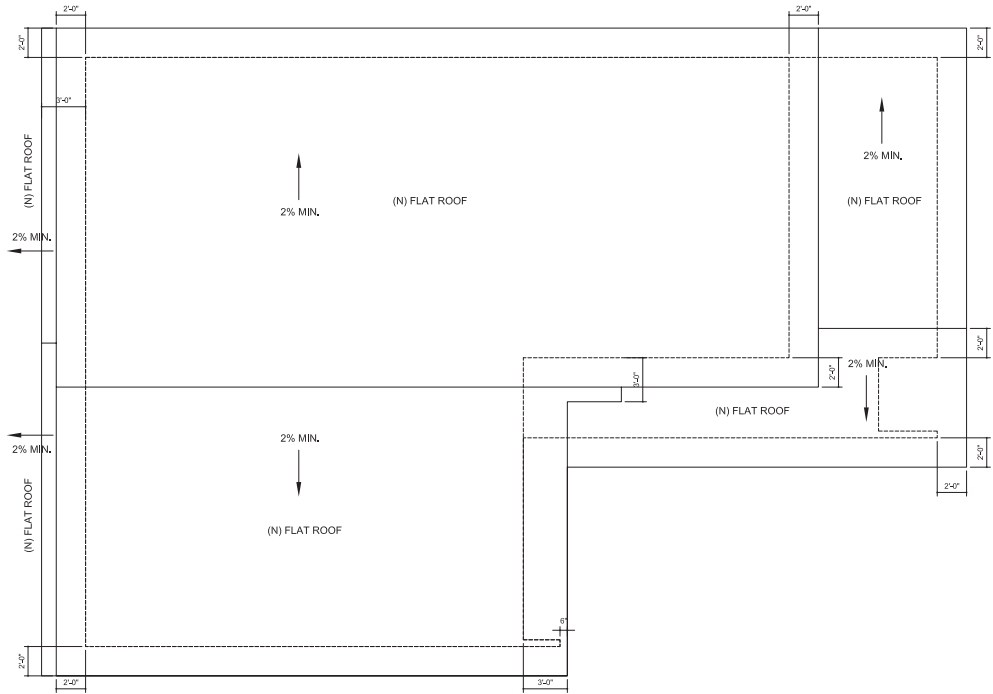

**PROPOSED ROOF PLAN**



REVISIONS	BY

PROPOSED ROOF PLAN  
**YAMAKITA RESIDENCE**  
 74 WOODHAMS ROAD  
 Santa Clara, CA, 95051


Date: \_\_\_\_\_  
 Sheet: **A4.2**




REVISIONS	BY




EXISTING EAST ELEVATION

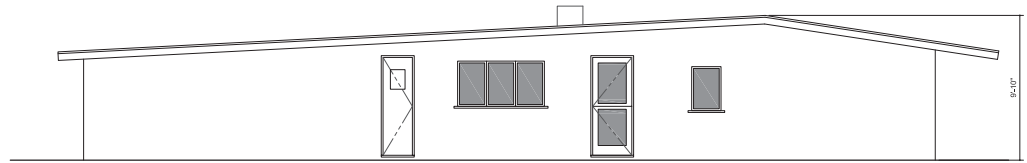

EXISTING NORTH ELEVATION

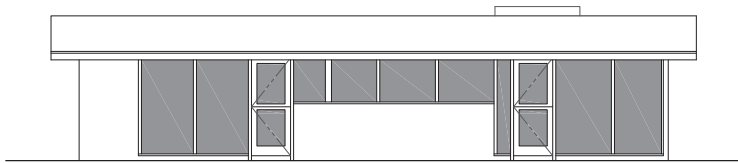


EXISTING WEST ELEVATION

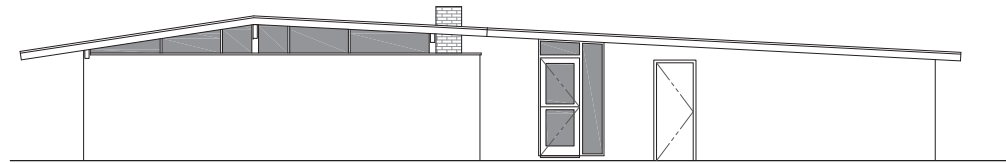

EXISTING SOUTH ELEVATION


EXISTING ELEVATIONS




EXISTING ELEVATIONS  
**YAMAKITA RESIDENCE**  
 74 WOODHAMS ROAD  
 Santa Clara, CA, 95051

Date: \_\_\_\_\_  
 Sheet

REVISIONS	BY

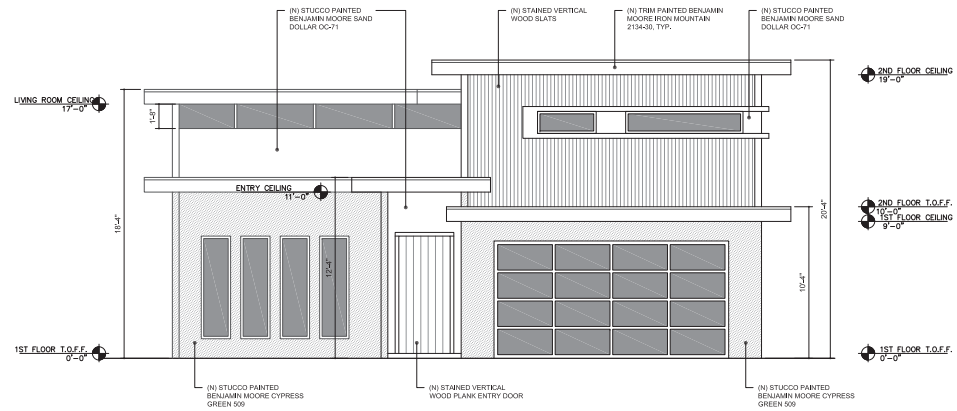

**PROPOSED EAST ELEVATION**

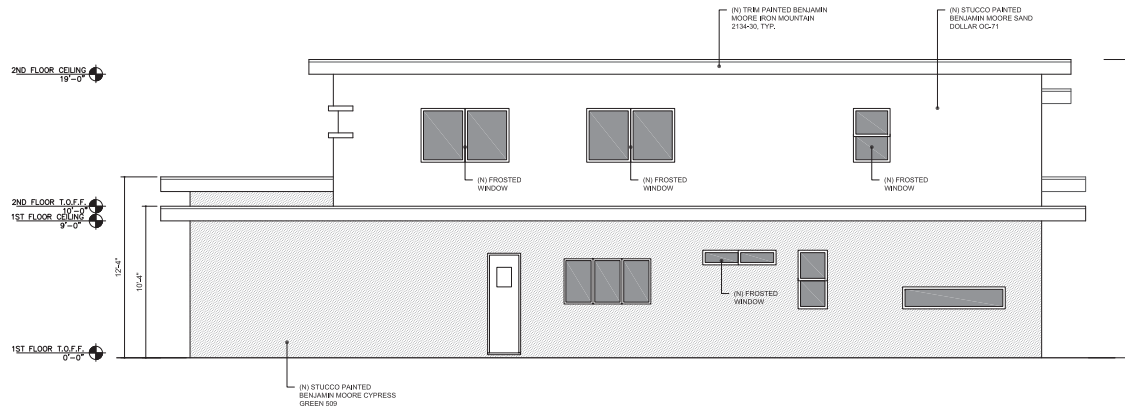

**PROPOSED NORTH ELEVATION**


**PROPOSED ELEVATIONS**




PROPOSED ELEVATIONS  
**YAMAKITA RESIDENCE**  
 74 WOODHAMS ROAD  
 Santa Clara, CA, 95051

Date:  
 Sheet:  
**A6.2**

REVISIONS	BY

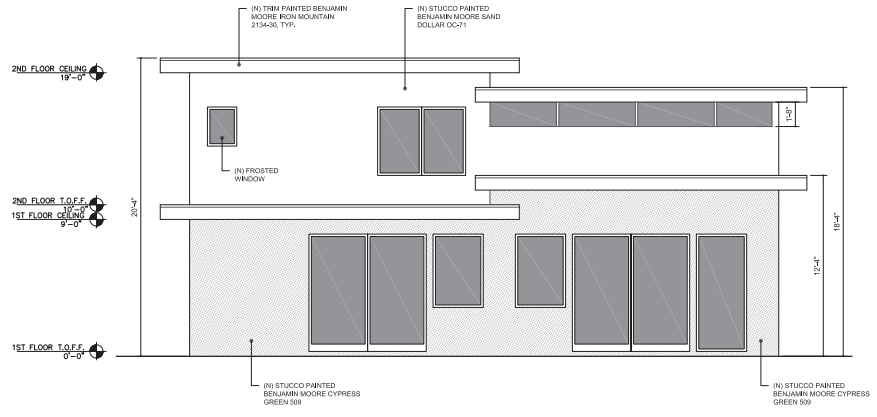

**PROPOSED WEST ELEVATION**

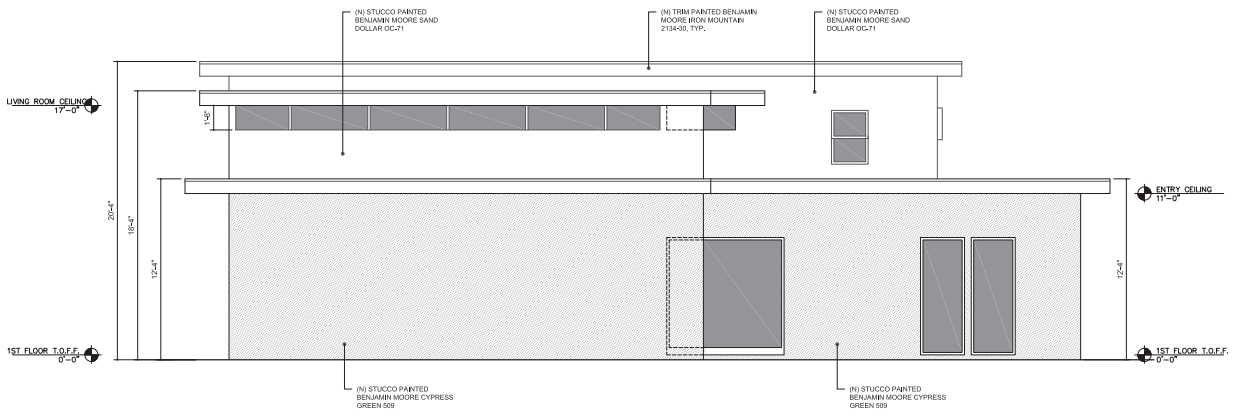

**PROPOSED SOUTH ELEVATION**

**PROPOSED ELEVATIONS**










PROPOSED ELEVATIONS  
**YAMAKITA RESIDENCE**  
 74 WOODHAMS ROAD  
 Santa Clara, CA, 95051

**A6.3**

## NOTES

ALL GLAZING IN HAZARDOUS LOCATIONS MUST BE IDENTIFIED BY A LABEL (PERMANENT IF TEMPERED) AS SAFETY GLAZING. HAZARDOUS LOCATIONS ARE IDENTIFIED AS FOLLOWS:

- GLAZING IN ALL DOORS
- GLAZING IN DOORS, WALLS (WITH THE EXPOSED EDGE OF GLAZING LESS THAN 60" ABOVE DRAIN INLET) AND ENCLOSURES FOR BATHTUBS, SHOWERS, WHIRLPOOLS, SPAS, ETC.
- GLAZING WITHIN A 24" ARC OF A DOOR EDGE.
- GLAZING PANELS OVER 9 SQUARE FEET HAVING THE LOWEST EDGE LESS THAN 18" ABOVE THE FINISH FLOOR AND HAVING A TOP EDGE GREATER THAN 36" ABOVE THE FLOOR, AND WITH 36" HORIZONTALLY OF A WALKING SURFACE.
- GLAZING IN GUARDRAILS.
- GLAZING IN WALL/FENCES USED AS POOL BARRIER FOR INDOOR AND OUTDOOR SWIMMING POOL.
- GLAZING WITHIN 36" HORIZONTALLY FROM THE WALKING SURFACE STAIRWAYS WITH BOTTOM EDGE LESS THAN 60" ABOVE WALKING SURFACE.

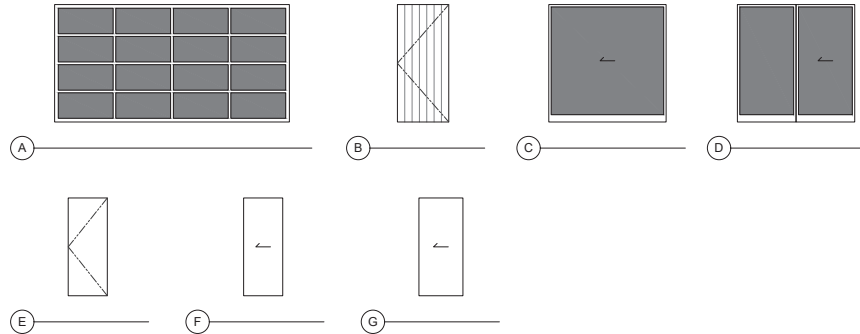


### DOOR TYPES

### DOOR SCHEDULE

- ALL NEW GLAZING SHALL COMPLY WITH STANDARDS OF THE U.S. CONSUMER PRODUCT SAFETY COMMISSION. MANUFACTURERS TO SUPPLY CERTIFICATE OF COMPLIANCE TO THE OWNER.

SIZE	STYLE					MATERIAL		FINISH		NOTES + BRAND
	WIDTH	HEIGHT	THICKNESS	TYPE	LITES	FRAME BODY	GLASS	INTERIOR	EXTERIOR	
① 16'-0"	8'-0"	1 3/4"	OVERHEAD 'A'		16	ALUMINUM	CLEAR/TEMPERED	BRONZE	BRONZE	GARAGE DOOR
② 3'-6"	8'-0"	1 3/4"	SWINGING 'B'		0	WOOD	-	STAINED	STAINED	EXTERIOR DOOR
③ 6'-0"	8'-0"	1 3/4"	POCKET 'C'		1	ALUMINUM	CLEAR/TEMPERED	BRONZE	BRONZE	EXTERIOR DOOR
④ 8'-0"	8'-0"	1 3/4"	SLIDING 'D'		2	ALUMINUM	CLEAR/TEMPERED	BRONZE	BRONZE	EXTERIOR DOOR
⑤ 2'-8"	8'-8"	1 3/4"	SWINGING 'E'		0	WOOD	-	PAINTED	PAINTED	INTERIOR DOOR
⑥ 2'-8"	8'-8"	1 3/4"	POCKET 'F'		0	WOOD	-	PAINTED	PAINTED	INTERIOR DOOR
⑦ 3'-0"	8'-8"	1 3/4"	SLIDING 'G'		0	WOOD	-	PAINTED	PAINTED	INTERIOR DOOR



### WINDOW TYPES

### WINDOW SCHEDULE:

NOTES:  
 - ALL NEW GLAZING SHALL COMPLY WITH STANDARDS OF THE U.S. CONSUMER PRODUCT SAFETY COMMISSION. MANUFACTURERS TO SUPPLY CERTIFICATE OF COMPLIANCE TO THE OWNER.  
 - THE LOAD RESISTANCE OF GLASS UNDER UNIFORM LOAD SHALL BE DETERMINED IN ACCORDANCE WITH ASTM E 1300.  
 - THE NFRC TEMPORARY LABEL DISPLAYED ON WINDOWS MUST REMAIN ON THE UNIT UNTIL FINAL INSPECTION HAS BEEN COMPLETED.

SIZE	STYLE					MATERIALS		FINISH		ACCESSORIES	U-FACTOR	SHGC	NOTES + BRAND	
	WIDTH	HEIGHT	TYPE	OPERATION	SASH	LITES	FRAMES / SASH	GLASS	INTERIOR					EXTERIOR
① 3'-0"	8'-0"	'A'	FIXED		1	1	ALUMINUM	CLEAR/ DUAL PANE/ LOW-E / TEMPERED	BRONZE	BRONZE	NO	0.28	0.20	
② 2'-0"	7'-0"	'A'	FIXED		1	1	ALUMINUM	CLEAR/ DUAL PANE/ LOW-E / TEMPERED	BRONZE	BRONZE	NO	0.28	0.20	
③ 3'-5"	8'-0"	'A'	FIXED		1	1	ALUMINUM	CLEAR/ DUAL PANE/ LOW-E / TEMPERED	BRONZE	BRONZE	NO	0.28	0.20	
④ 3'-5"	5'-0"	'A'	FIXED		1	1	ALUMINUM	CLEAR/ DUAL PANE/ LOW-E / TEMPERED	BRONZE	BRONZE	NO	0.28	0.20	
⑤ 7'-0"	1'-6"	'A'	FIXED		1	1	ALUMINUM	CLEAR/ DUAL PANE/ LOW-E / TEMPERED	BRONZE	BRONZE	NO	0.28	0.20	
⑥ 2'-0"	4'-0"	'B'	SINGLE-HUNG		2	2	ALUMINUM	CLEAR/ DUAL PANE/ LOW-E	BRONZE	BRONZE	YES	0.28	0.20	
⑦ 5'-0"	1'-0"	'C'	SLIDING		2	2	ALUMINUM	FROSTED/ DUAL PANE/ LOW-E	BRONZE	BRONZE	YES	0.28	0.20	
⑧ 8'-0"	1'-6"	'A'	FIXED		1	1	ALUMINUM	CLEAR/ DUAL PANE/ LOW-E	BRONZE	BRONZE	NO	0.28	0.20	
⑨ 4'-0"	1'-6"	'A'	FIXED		1	1	ALUMINUM	CLEAR/ DUAL PANE/ LOW-E	BRONZE	BRONZE	NO	0.28	0.20	
⑩ 2'-6"	3'-8"	'B'	SINGLE-HUNG		2	2	ALUMINUM	FROSTED/ DUAL PANE/ LOW-E	BRONZE	BRONZE	YES	0.28	0.20	
⑪ 8'-0"	4'-8"	'D'	SLIDING		2	2	ALUMINUM	CLEAR/ DUAL PANE/ LOW-E / TEMPERED	BRONZE	BRONZE	YES	0.28	0.20	
⑫ 2'-0"	2'-8"	'E'	CASEMENT		1	1	ALUMINUM	FROSTED/ DUAL PANE/ LOW-E / TEMPERED	BRONZE	BRONZE	YES	0.28	0.20	
⑬ 6'-0"	3'-8"	'D'	SLIDING		2	2	ALUMINUM	FROSTED/ DUAL PANE/ LOW-E	BRONZE	BRONZE	YES	0.28	0.20	

## DOOR AND WINDOW SCHEDULES

REVISIONS	BY

DOOR AND WINDOW SCHEDULES  
**YAMAKITA RESIDENCE**  
 74 WOODHAMS ROAD  
 Santa Clara, CA, 95051

A8.1